




NO.	REVISION	BY	DATE	MATERIAL I.D.
0	APPROVED	WW	03-01-17	SPC-A8

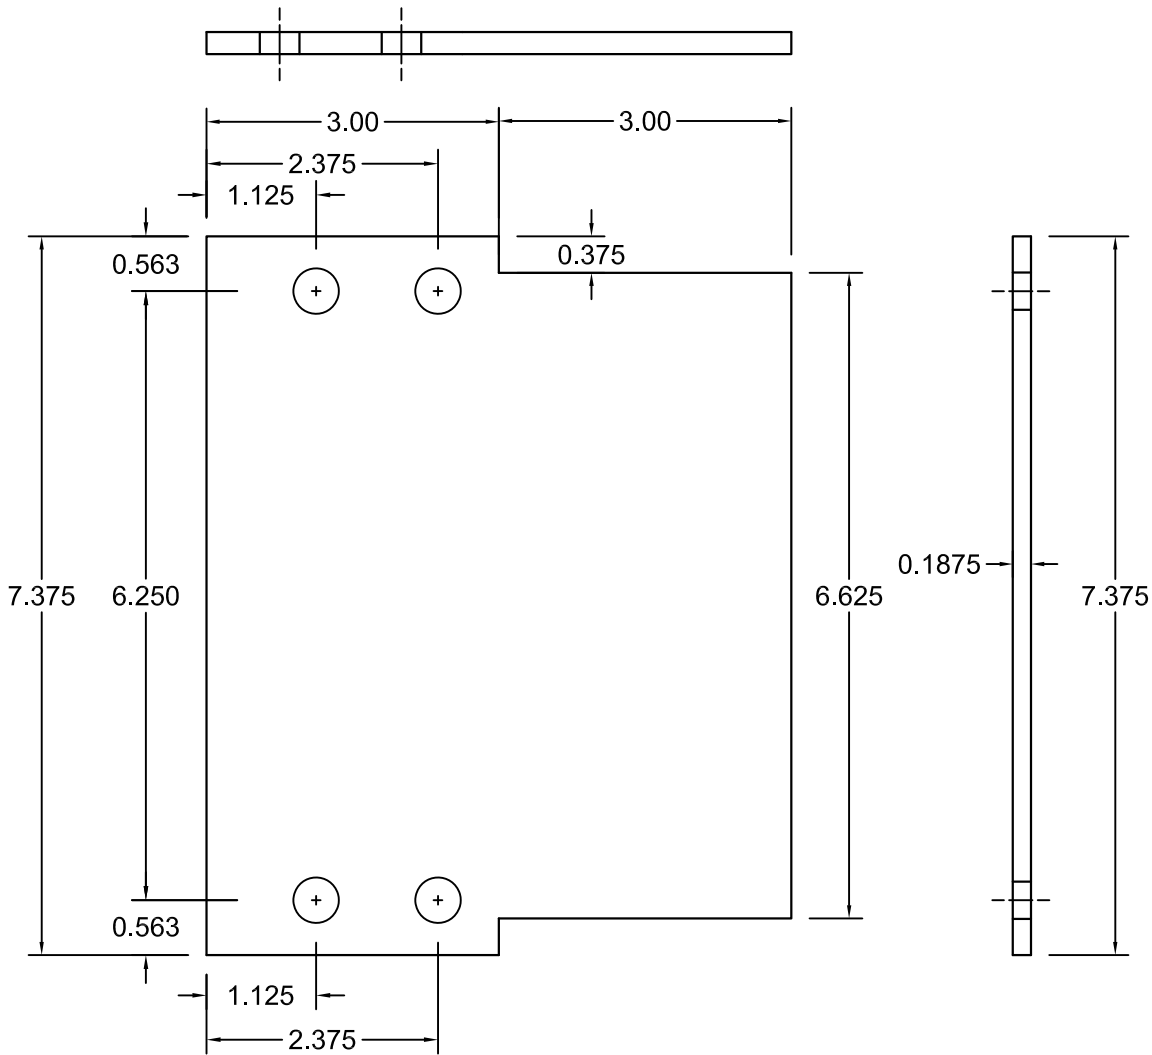

**NOTES:**

1. COMPLETE ASSEMBLY CONSISTS OF (2) PLATES WITH FASTENERS INDICATED.
2. THESE PLATES ARE USED TO JOIN U.S.P. 8" HIGH CABLE TRAY SYSTEM A820E TO 8" HIGH TRAYS SUPPLIED BY OTHERS.
3. INSTALL IN ACCORDANCE WITH NEMA STANDARD VE-2 CABLE TRAY INSTALLATION GUIDELINES.
4. THESE PLATES ARE DESIGNED FOR USE WITH CLASS 4 CABLE TRAY SYSTEM A820E.

‡	F*	FASTENER MATERIAL	INCLUDED FASTENERS	FASTENER CATALOG NO.	QTY.
	G	GEOMET-PLATED STEEL	3/8" x 3/4" RIBBED-NECK SCREW	F-RNS-38-34-G	16
			3/8" FLANGED HEX NUT	F-FHN-38-G	16
	S	TYPE 316 STAINLESS STEEL	3/8" x 3/4" RIBBED-NECK SCREW	F-RNS-38-34-S	16
			3/8" FLANGED HEX NUT	F-FHN-38-S	16

‡ MARK "√" IN BOX TO INCLUDE IN SUBMITTAL



CABLE TRAYS EMPLOYING THESE CONNECTORS ARE CLASSIFIED BY UNDERWRITERS LABORATORIES TO BE SUITABLE FOR USE AS EQUIPMENT GROUNDING CONDUCTORS. BONDING JUMPERS ARE NOT REQUIRED TO MAINTAIN GROUND PATH INTEGRITY. RESISTANCE ACROSS COUPLING IS LESS THAN 0.00033 OHMS. CERTIFIED BY U.L. TO MEET NEC. 392 AND NEMA STD. VE1, CSA-C22.2 NO. 126.1.

**MATERIAL:** ALUMINUM ALLOY 5052-H32

NOTE: ALL DIMENSIONS ARE SUBJECT TO THE MANUFACTURING TOLERANCE SPECIFICATIONS IN DOCUMENT USP-QA-05-02.

**ATKORE**

560 WHARTON CIRCLE, SUITE E ATLANTA, GA 30336 USA  
 PHONE: 404-696-8585 FAX: 404-696-8599

SHEET NO.  
1 OF 1

DIMENSIONS  
INCHES

DESCRIPTION  
**CONVERSION CONNECTOR FOR 8" SYSTEM A820E**

CATALOG NUMBER	CATALOG NUMBER VARIABLES
<b>SPC-A8-(F*)8</b>	F* = FASTENER MATERIAL (G OR S)