




NO.	REVISION	BY	DATE	MATERIAL I.D.
0	APPROVED	TM	06-18-15	SPFS

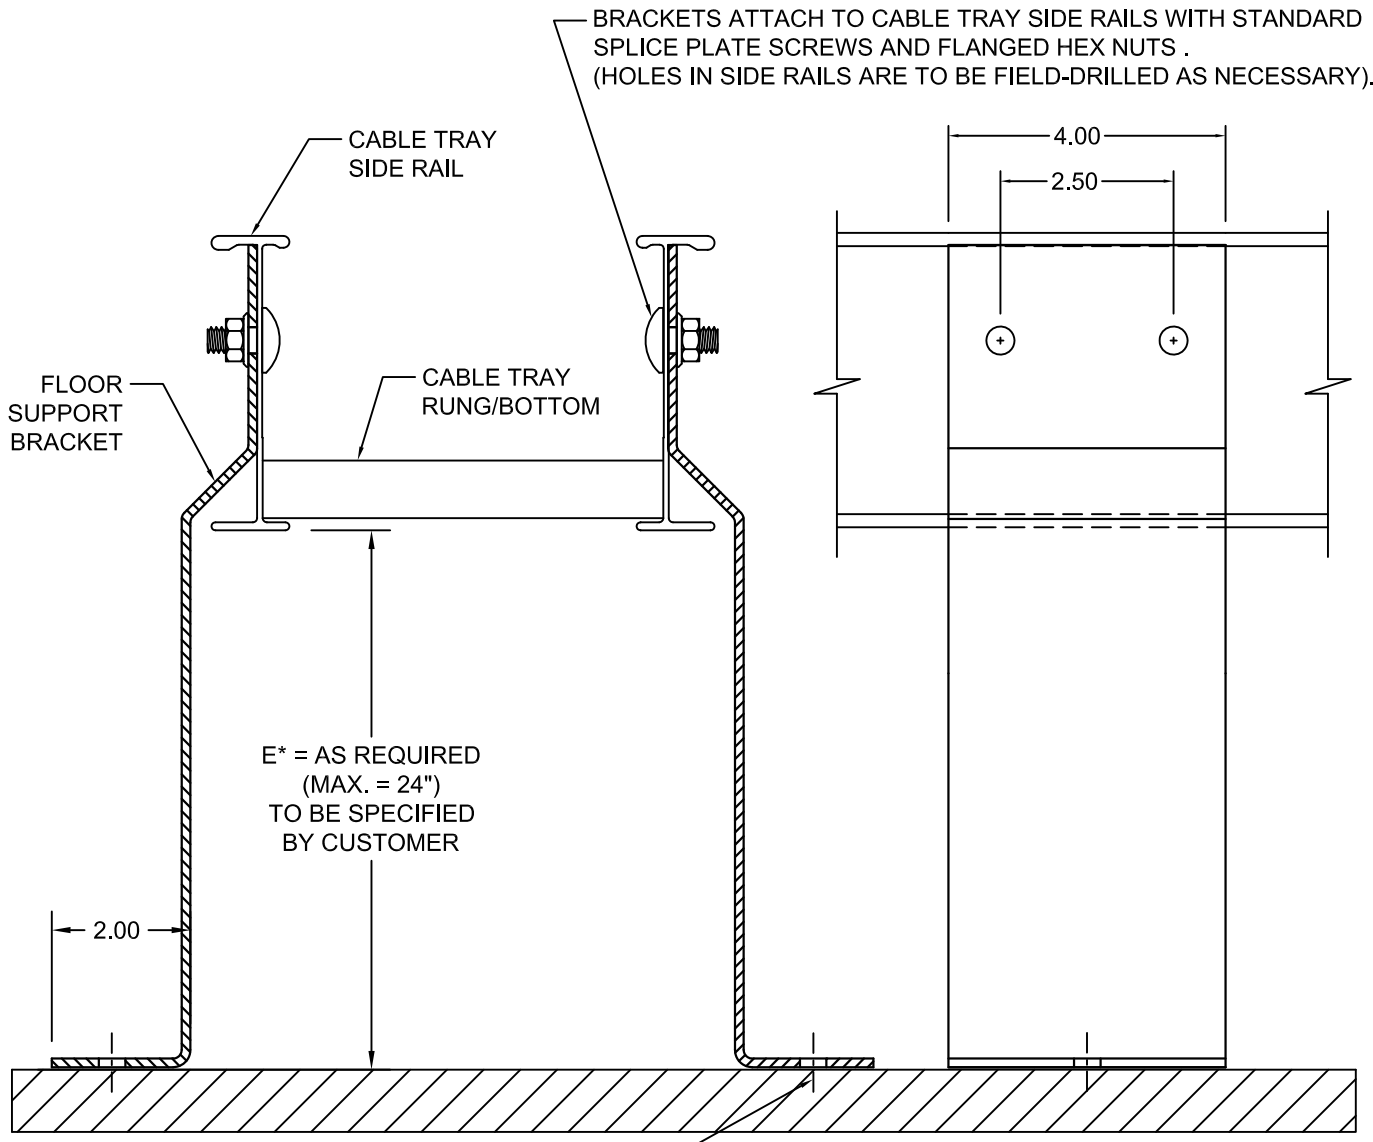

1/16" DIA. HOLE IN BOTTOM LEG OF BRACKET ACCEPTS 1/2" DIA. FASTENERS (NOT INCLUDED) FOR FLOOR ATTACHMENT. HOLE SIZE CAN BE VARIED IF NEEDED.

**NOTES:**

- FLOOR SUPPORT BRACKETS ARE SUPPLIED IN PAIRS WITH FASTENERS. COMPLETE ASSEMBLY CONSISTS OF (2) PLATES WITH (4) 3/8" x 3/4" RIBBED-NECK SCREWS AND (4) 3/8" FLANGED HEX NUTS. FASTENERS ARE GEOMET-PLATED STEEL (G) OR 316 STAINLESS STEEL (S).
- FASTENERS FOR FLOOR ATTACHMENT ARE NOT INCLUDED.

**INSTALLATION:** INSTALL AT SUPPORT LOCATIONS IN ACCORDANCE WITH NEMA STD. PUBLICATION VE-2 "CABLE TRAY INSTALLATION GUIDELINES".

**MATERIAL:** ALUMINUM ALLOY 5052-H32  
 NOTE: ALL DIMENSIONS ARE SUBJECT TO THE MANUFACTURING TOLERANCE SPECIFICATIONS IN DOCUMENT USP-QA-05-02.

<b>ATKORE</b>		SHEET NO. 1 OF 1
560 WHARTON CIRCLE, SUITE E ATLANTA, GA 30336 USA		PHONE: 404-696-8585 FAX: 404-696-8599
DIMENSIONS INCHES		
<b>DESCRIPTION</b> FLOOR SUPPORT BRACKET FOR ELEVATED CABLE TRAY		
<b>CATALOG NUMBER</b> SPFS-A(H*)-(E*)-(F*)-2	<b>CATALOG NUMBER VARIABLES</b> H* = NOMINAL TRAY SIDE RAIL HEIGHT IN INCHES (4, 5, 6, 7) F* = FASTENER MATERIAL (G OR S)	